# For Health Hazard Applications

Job Name	Contractor
Job Location	Approval
Engineer	Contractor's P.O. No.
Approval	Representative

# Series 009

# Reduced Pressure Zone Assemblies

Sizes: 1/4" - 2"

Series 009 Reduced Pressure Zone Assemblies are designed to protect potable water supplies in accordance with national plumbing codes and water authority requirements. This series is designed to protect drinking water supplies from dangerous cross-connections in accordance with national plumbing codes and water authority requirements for non-potable service applications such as irrigation, fireline, or industrial processing.

This series features two in-line, independent check valves, captured springs and replaceable check seats with an intermediate relief valve. Its compact modular design facilitates easy maintenance and assembly access. Sizes ½" – 1" shutoffs have tee handles.

## **Features**

- Single access cover and modular check construction for ease of maintenance
- Top entry all internals immediately accessible
- Captured springs for safe maintenance
- Internal relief valve for reduced installation clearances
- Replaceable seats for economical repair
- Bronze body construction for durability 1/4" 2"
- Ball valve test cocks screwdriver slotted 1/4" 2"
- Large body passages provides low pressure drop
- Compact, space saving design
- No special tools required for servicing


## **Specifications**

A Reduced Pressure Zone Assembly shall be installed at each potential health hazard location to prevent backflow due to backsiphonage and/or backpressure. The assembly shall consist of an internal pressure differential relief valve located in a zone between two positive seating check modules with captured springs and silicone seat discs. Seats and seat discs shall be replaceable in both check modules and the relief valve. There shall be no threads or screws in the waterway exposed to line fluids. Service of all internal components shall be through a single access bronze cover secured with stainless steel bolts. The assembly shall also include two resilient seated isolation valves, four resilient seated test cocks and an air gap drain fitting. The assembly shall meet the requirements of: USC; ASSE Std. 1013; AWWA Std. C511-92; CSA B64.4. Shall be a Watts Series 009.

†Does not indicate approval status. Refer to Page 2 for approved sizes & models.



009M2QT

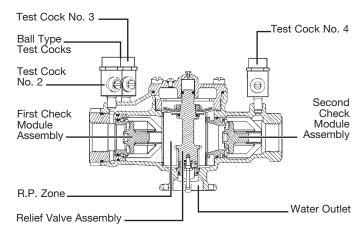

# Now Available WattsBox Insulated Enclosures.

For more information, send for literature ES-WB.

#### NOTICE

Inquire with governing authorities for local installation requirements

### NOTICE

The information contained herein is not intended to replace the full product installation and safety information available or the experience of a trained product installer. You are required to thoroughly read all installation instructions and product safety information before beginning the installation of this product.



## Available Models: 1/4" - 2"

#### Suffix:

QT - quarter-turn ball valves

S - bronze strainer

LF - without shutoff valves

AQT - elbow fittings for 360° rotation

3/4" - 2" only

PC - internal Polymer Coating

SH - stainless steel ball valve handles

HC - 2½" inlet/outlet fire hydrant fitting (2" valve)

#### Prefix:

C – clean and check strainer <sup>3</sup>/<sub>4</sub>" – 1" only
 U – union connections (see ES-U009)

Materials: 1/4" - 2"

Bronze body construction, silicone rubber disc material in the first and second check plus the relief valve. Replaceable polymer check seats for first and second checks. Removable Relief valve seats. Stainless steel cover bolts.

Standardly furnished with NPT body connections. For optional bronze union inlet and outlet connections, specify prefix U ( $\frac{1}{2}$ " – 2"). Series 009QT furnished with quarter turn, full port, resilient seated, bronze ball valve shutoffs.

# Pressure / Temperature

**Series 009** ¼" – 2" Suitable for supply pressure up to 175psi (12.1 bar). Water temperature: 33°F – 180°F (0.5°C – 75°C).

#### **Standards**

USC

ASSE No. 1013 AWWA C511-92

CSA B64.4

IAPMO File No. 1563.

†Does not indicate approval status. See below for approved models.









## **Approvals**

ASSE, AWWA, CSA, IAPMO


Approved by the Foundation for Cross-Connection Control and Hydraulic Research at the University of Southern California.

UL Classified 3/4" - 2"

(LF models only except 009M3LF)


# Air Gaps and Elbows

MODEL		DRAIN	OUTLET		DIMEN	WEIGHT			
	for 909, 009 and 993 sizes				A	E	3		
		in.	mm	in.	mm	in.	mm	lbs.	kgs.
909AGA	1/4"-1/2" 009,	1/2	13	23/8	60	31//8	79	0.625	0.28
	3/4" 009M2/M3								
909AGC	3/4"-1" 009/909,	1	25	31/4	83	47/8	124	1.5	0.68
	1"-1½" 009M2								
909AGF	1¼"-2" 009M1,	2	51	43/8	111	6¾	171	3.25	1.47
	11/4"-3" 009/909,								
	2" 009M2, 4"-6" 993								
909AGK	4"-6" 909,	3	76	6%	162	95/8	244	6.25	2.83
	8"-10" 909M1								
909AGM	8"-10" 909	4	102	7%	187	1111/4	286	15.5	7.03
909ELA	1/4"-1/2" 009, 3/4" 009M2/M3	_	_	_	_	_	_	_	_
909ELC	3/4"-1" 009/909	_	-	23/8	60	23/8	60	0.38	0.17
* 909ELF	1¼"-2" 009M1,	_	_	35/8	92	35/8	92	2	0.91
	11/4"-2" 009/909,								
	2" 009M2, 4"-6" 993								
* 909ELH	21/2"-3" 009/909	-	_	-	_	-	_	_	_
Vertical									

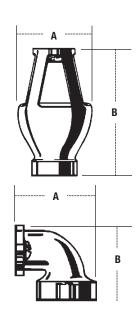

<sup>\*</sup> Epoxy coated

# Dimensions and Weight: 1/4" - 2" 009

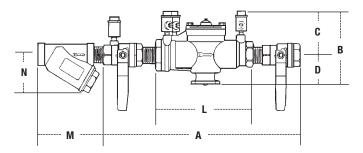


009 1/4" - 2"


SIZE	DIMENSIONS (APPROX.)											WEIGHT				
	A	4	В		С		D		L		M		N			
in.	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kgs.
1/4	10	250	45/8	117	33//8	86	11/4	32	51/2	140	23/8	60	21/2	64	5	2
3/8	10	250	45/8	117	3%	86	11/4	32	5½	140	23//8	60	21/2	64	5	2
1/2	10	250	45/8	117	3%	86	11/4	32	5½	140	23/4	70	21/4	57	5	2
3/4	10¾	273	5	127	31/2	89	11/2	38	63/4	171	33/16	81	23/4	70	6	3
1	141/2	368	5½	140	3	76	21/2	64	91/2	241	33/4	95	3	76	12	5
11/4	17%	441	6	150	31/2	89	21/2	64	11%	289	47/16	113	31/2	89	15	6
11/2	171//8	454	6	150	31/2	89	<b>2</b> ½	64	1111//	283	47/8	124	4	102	16	7
2	21%	543	73/4	197	41/2	114	31/4	83	13½	343	5 <sup>15</sup> / <sub>16</sub>	151	5	127	30	13


Suffix HC - Fire Hydrant Fittings dimension 'A' = 25"


# Capacity


Performance as established by an independent testing laboratory.\*Typical maximum system flow rate (7.5 feet/sec., 2.3 meters/sec.)

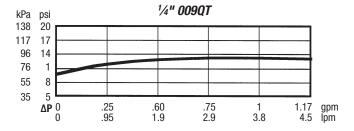

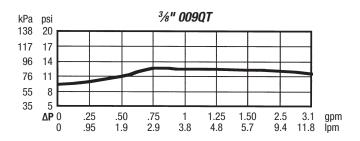


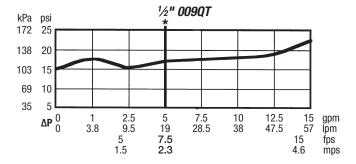


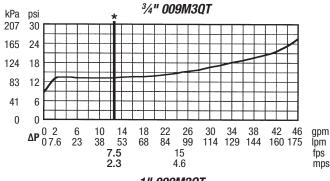

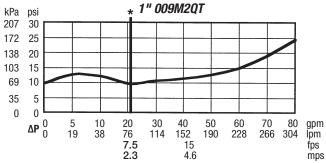



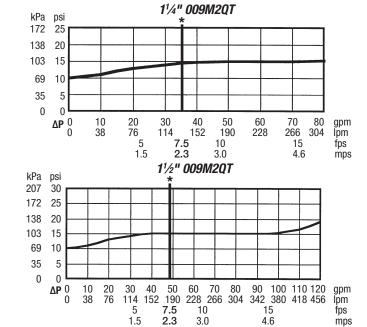

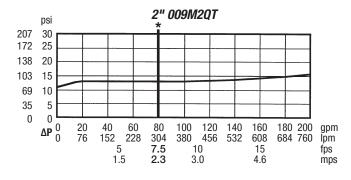

USA: T: (978) 689-6066 • F: (978) 975-8350 • Watts.com
Canada: T: (905) 332-4090 • F: (905) 332-7068 • Watts.ca
Latin America: T: (52) 81-1001-8600 • Watts.com

ES-009 1813 © 2018 Watts