

T9 Tank Order - Submittal Sheet

Job Name _____
 Job Location _____
 Orion Representative _____

Contractor Signature _____
 Approval Date _____
 Contractor's P.O. No. _____


All Tank/SI Drawings Must Be Signed Off And Accompany PO Before Product Will Be Manufactured.

T9 Point-Of-Use Dilution Tank

Specification

Orion T9 POU 5 USG Tank shall be cylindrical seamless, stress and defect free, rotationally molded construction including integral cover to uniform wall thickness from virgin PE resins conforming to ASTM D 1248, with **single FIP inlet, with dip tube, outlet and vent, plus top 6" cleanout as standard.** All penetrations shall be heat fused to tank wall.

Connection Size Options Inlet/Outlet	
<input type="checkbox"/>	1.5"
<input type="checkbox"/>	2"

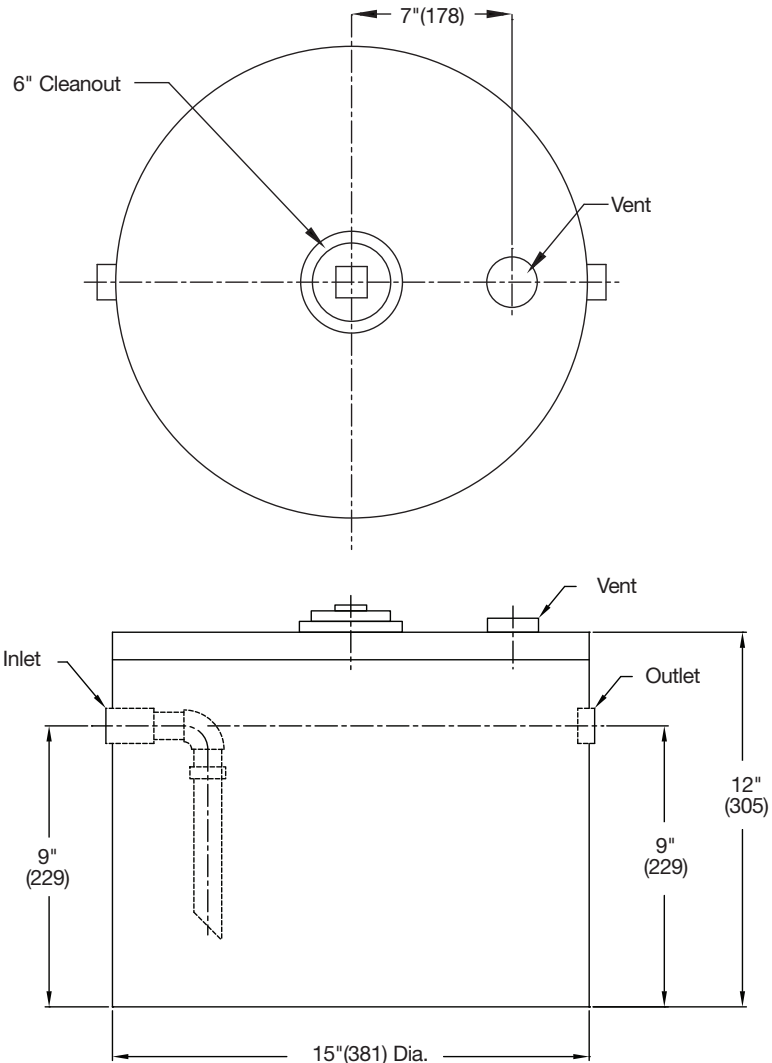

Note: Dimensions are inches (mm).
Note: Tanks are made to ± 0.25 in. tolerance.

NOTICE

The information contained herein is not intended to replace the full product installation and safety information available or the experience of a trained product installer. You are required to thoroughly read all installation instructions and product safety information before beginning the installation of this product.

Please verify all selections with your local Orion rep - tank products and accessory equipment are non-returnable.

Orion Fittings product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Orion Fittings Technical Service. Orion Fittings reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Orion Fittings products previously or subsequently sold.



USA: T: (800) 334-6259 • OrionFittings.com
Canada: T: (905) 332-4090 • F: (905) 332-7068 • OrionFittings.ca
Latin America: T: (52) 81-1001-8600 • OrionFittings.com

A WATTS Brand