## For Non-Health Hazard Applications

Job Name	Contractor
Job Location	Approval
Engineer	Contractor's P.O. No.
Approval	Representative

# 니크<u>사</u>이 크리크 HydroGuard® XP LFSH1434 Triple Valve


## Supply Fixture — Exposed

#### **Features**

- Features Lead Free\* construction to comply with Lead Free\* installation requirements.
- Paraffin-based advanced thermal actuation technology to sense and adjust outlet temperature
- Dirt and lime resistant poppet and seat design
- Virtual shutoff if supply pressure fails
- Vandal-resistant locking mechanism to secure temperature setting
- Factory tested as a complete unit
- Mounted on heavy-duty welded struts
- Pressure/Temperature Gauges, Ball valves

#### **Specifications**

Connections	See ordering information
Maximum Hot Water Supply Temperature	200°F (93°C)
Minimum Hot Water Supply Temperature**	5°F (3°C) Above Set Point
Minimum Flow***	0.5 gpm (1.9 lpm)
Maximum Operating Pressure	125 psi (861 kPa)
Temperature Adjustment Range****	90 – 160°F (32 – 71°C)
Hot Water Inlet Temperature Range	120 – 180°F (49 – 82°C)
Cold Water Inlet Temperature Range	40 - 80°F (4 - 27°C)
Listing/Compliance (Valve Only)	ASSE 1017, CSA B125









Advanced Thermal Activation


- \* The wetted surface of this product contacted by consumable water contains less than one quarter of one percent (0.25%) of lead by weight.
- \*\* With Equal Pressure
- \*\*\* Minimum flow when Hi/Lo valve is installed at or near hot water source recirculating tempered water with a properly sized continuously operating recirculating nume.
- recirculating pump.

  \*\*\*\* Note: Low limit cannot be less than the cold water temperature. For best operation, hot water should be at least 5°F (3°C) above desired set point.


#### Capacity

Flow Capacity at 50-50 Mixed Ratio									
		Pressure Drop Across Valve							
Model	Min. Flow	Cv	5 psi	10 psi	20 psi	30 psi	45 psi	60 psi	
	to ASSE 1017		(34 kPa)	(69 kPa)	(138 kPa)	(207 kPa)	(310 kPa)	(414 kPa)	
LFSH1434TV	1 gpm	62.00	139 gpm	196 gpm	277 gpm	340 gpm	416 gpm	480 gpm	
	4 lpm	02.00	526 lpm	742 lpm	1049 lpm	1287 lpm	1575 lpm	1817 lpm	



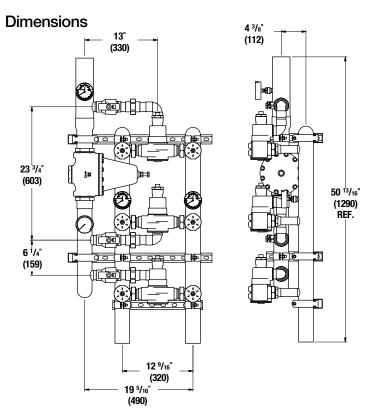

Note: Dimensions are shown ±½" Dimensions in parentheses are in mm

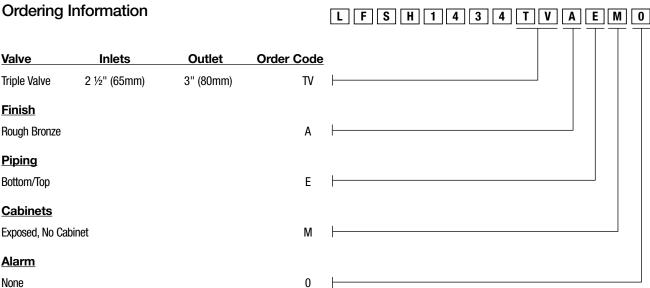

#### Recirculation Piping Diagram

Please see Piping Diagram Section of this catalog.

### **Typical Specification**

Triple Valve Hi/Lo Temperature Control System should include three thermostatic valves capable of maintaining water temperature to within the range of  $90 - 160^{\circ}$ F ( $32 - 71^{\circ}$ C). Valves must compensate for fluctuations due to inlet water temperature changes. The valves shall be constructed using Lead Free\* brass. Lead Free\* brass valves shall comply with state codes and standards, where applicable, requiring reduced lead content. Valves shall have triple-duty checkstops and must have advanced, paraffin-based thermal actuation technology in order to guarantee a precise control when tested in accordance with ASSE 1017 and CSA B125. Thermostatic valves must be ASSE listed and CSA approved.

Triple-valve Hi/Lo system must include PRV, ball valves, pressure/temperature gauges and mounted on heavy-duty metal struts.

The Hi/Lo system shall be of Powers' LFSH1434TV. Any alternate must have a written approval prior to bidding.



A WATTS Brand

USA: Tel: (800) 669-5430 • Fax: (847) 229-0526 • PowersControls.com

Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • PowersControls.ca

Latin America: Tel: (52) 81-1001-8600 • PowersControls.com